


REG2 A/W

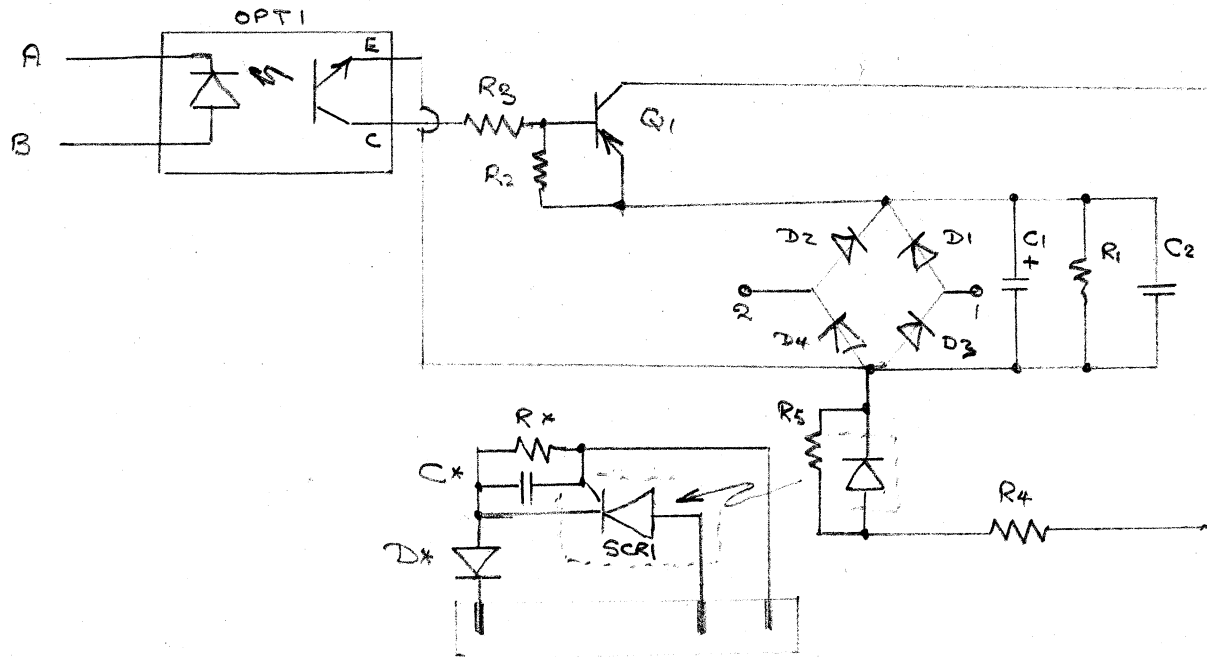

Q1	2N2907A
OPT1	CNY 65
SCR1	H11C6
R1	27K
R2	10K
R3	4K7
R4	680
R5	10K
R*	27K
C1	100μ 35V
C2	100n 50V
C*	47n 50
D*	1N4007

Nominal 20V DC Across
C1, C2.

~15V AC Across 1, 2.

TRIGGER CURRENT A ~ B
~8mA TO OPERATE Q1
75mA MAXIMUM.

SCR1 400V @ 5A SUGGEST

As ATTACHED To
24D10-17
SSR MODULES.