




<http://www.casa.co.nz>

Edition: 01/02/2012

Visio File: 12V--12VDC-5A-IE12_02PM5-Innovative-Schema

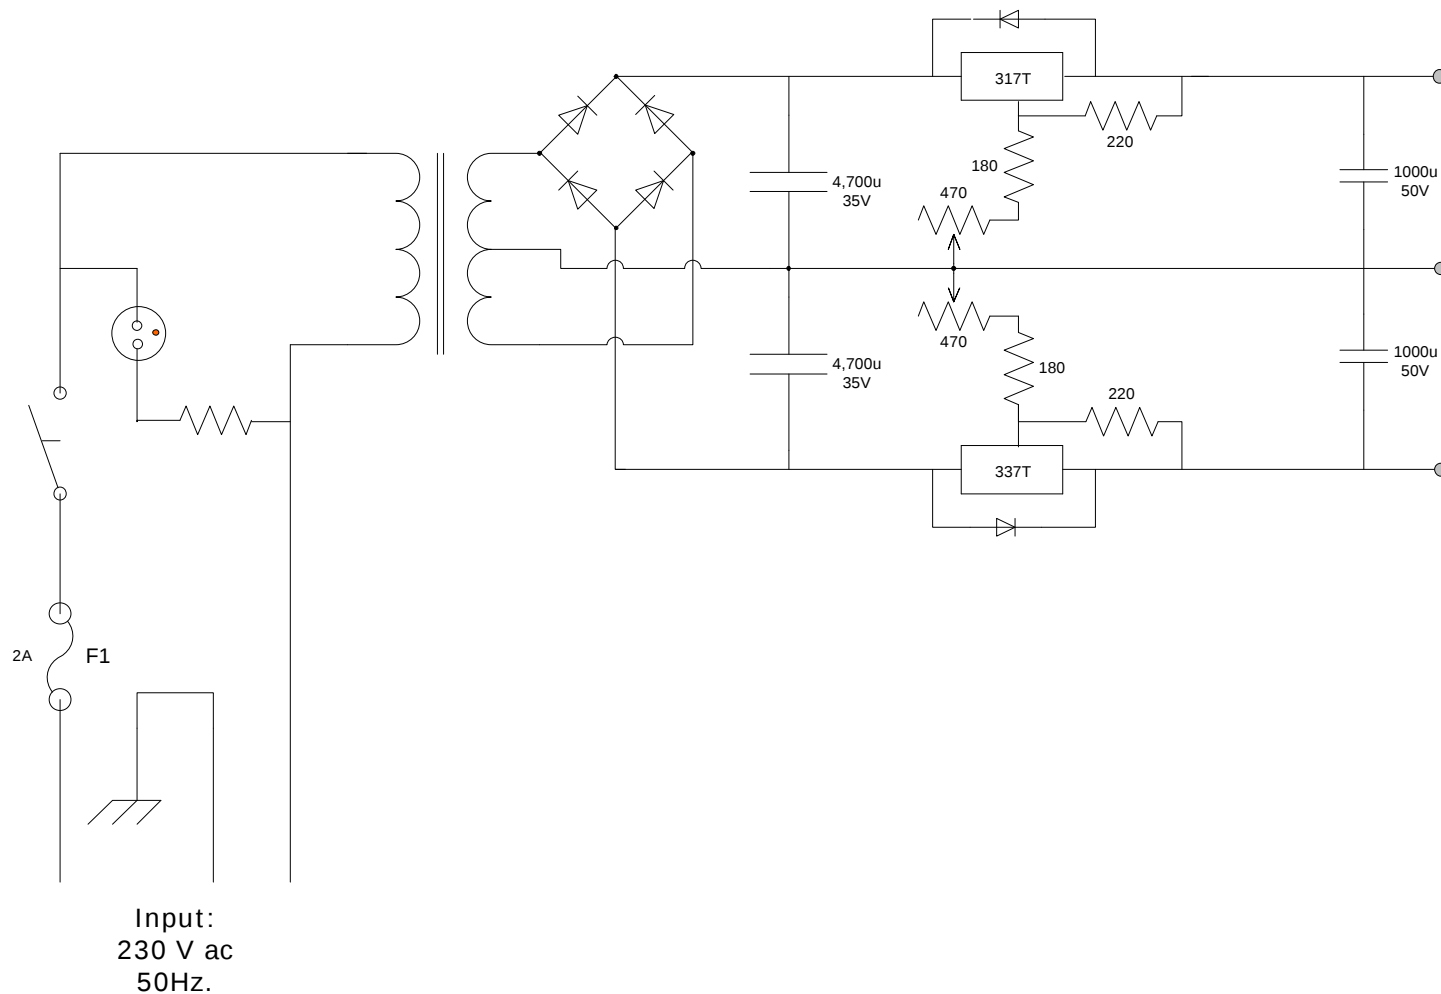

Transient Suppression.

For improved transient protection when connected to inductive loads we recommend installing some ferrite beads in the output circuit.

Innovative Energies
IE 12/02PM
Regulated Power
Supply