




Not registered

CASA

<http://www.casa.co.nz>

Edition: 01/02/2012

Visio File: 48V-3A-IE48_3-Innovative-Schema

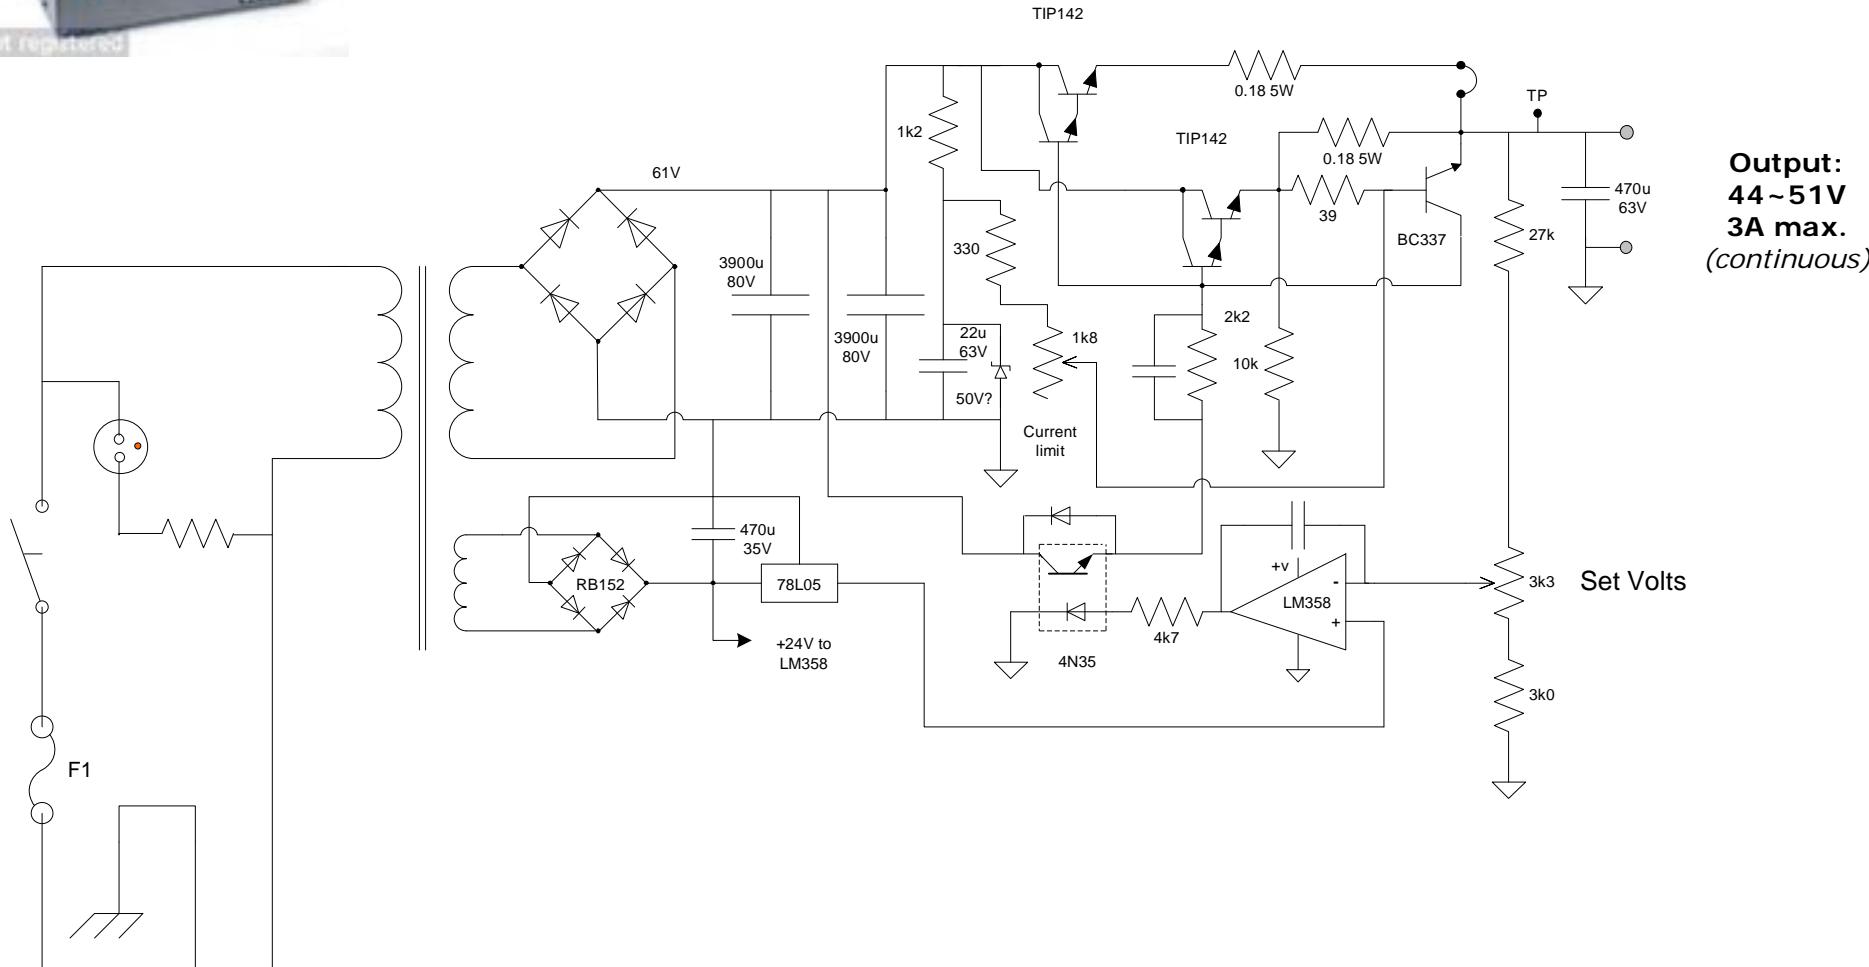

Transient Suppression.

For improved transient protection when connected to inductive loads we recommend installing some ferrite beads in the output circuit.

**Innovative Energies
IE 48/3
Regulated Power Supply**