


**CASA**<http://www.casa.co.nz>

Edition: 01/02/2012

Visio File: 24V-5A-IE24\_05-Innovative-Schema



12345-lizard.com

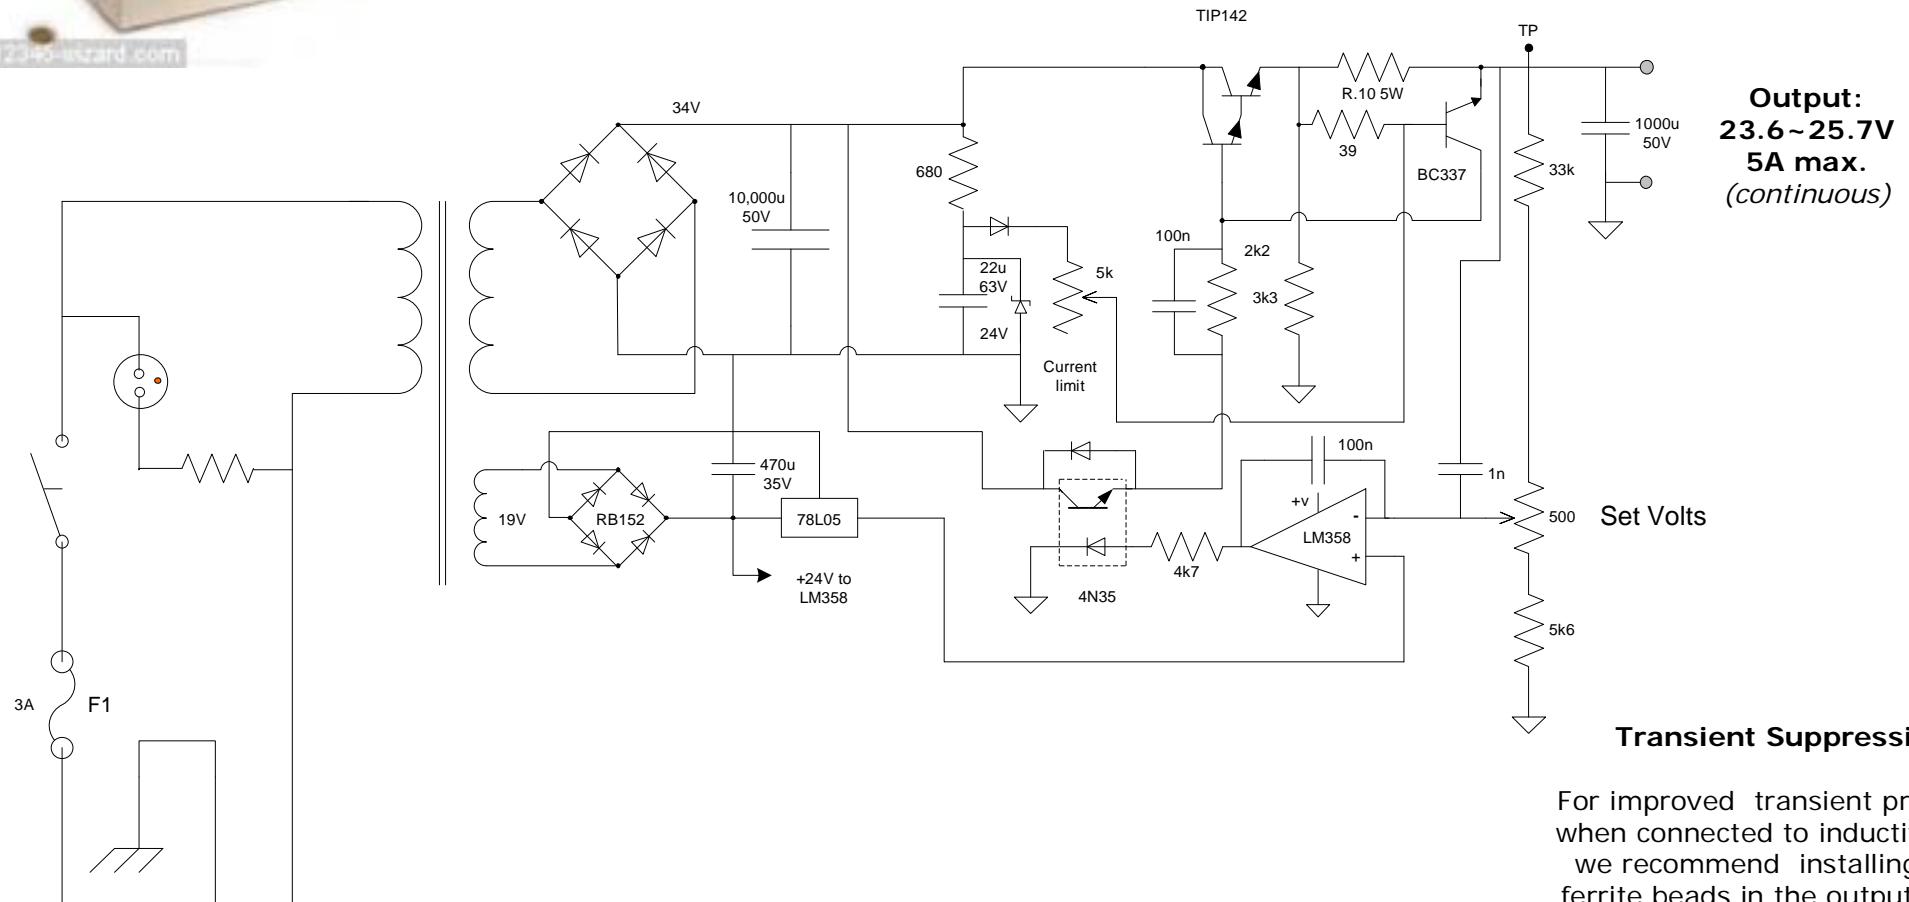

For improved transient protection when connected to inductive loads we recommend installing some ferrite beads in the output circuit.

Innovative Energies  
IE 24/05  
Regulated Power Supply